


GENERAL NOTES:

- HOLE IN MEMBRANE SHOULD EXTEND A MINIMUM OF 1/2" (13 mm) BEYOND CLAMPING RING AND SHOULD BE LARGER THAN THE DIAMETER OF THE LEADER PIPE.
- INSULATION ADJACENT TO THE DRAIN TO BE ELEVATE INSULATION OR EQUIVALENT WITH MANF. PROVIDED BONDING AND ADEQUATE BONDING SURFACE.
- ELEVATE WATERBLOCK OR EQUIVALENT MIN 1/2 OF 10 OZ. (295 ML) TUBE PER 4" DRAIN. USE ADDITIONAL WATERBLOCK FOR LARGER DRAINS.

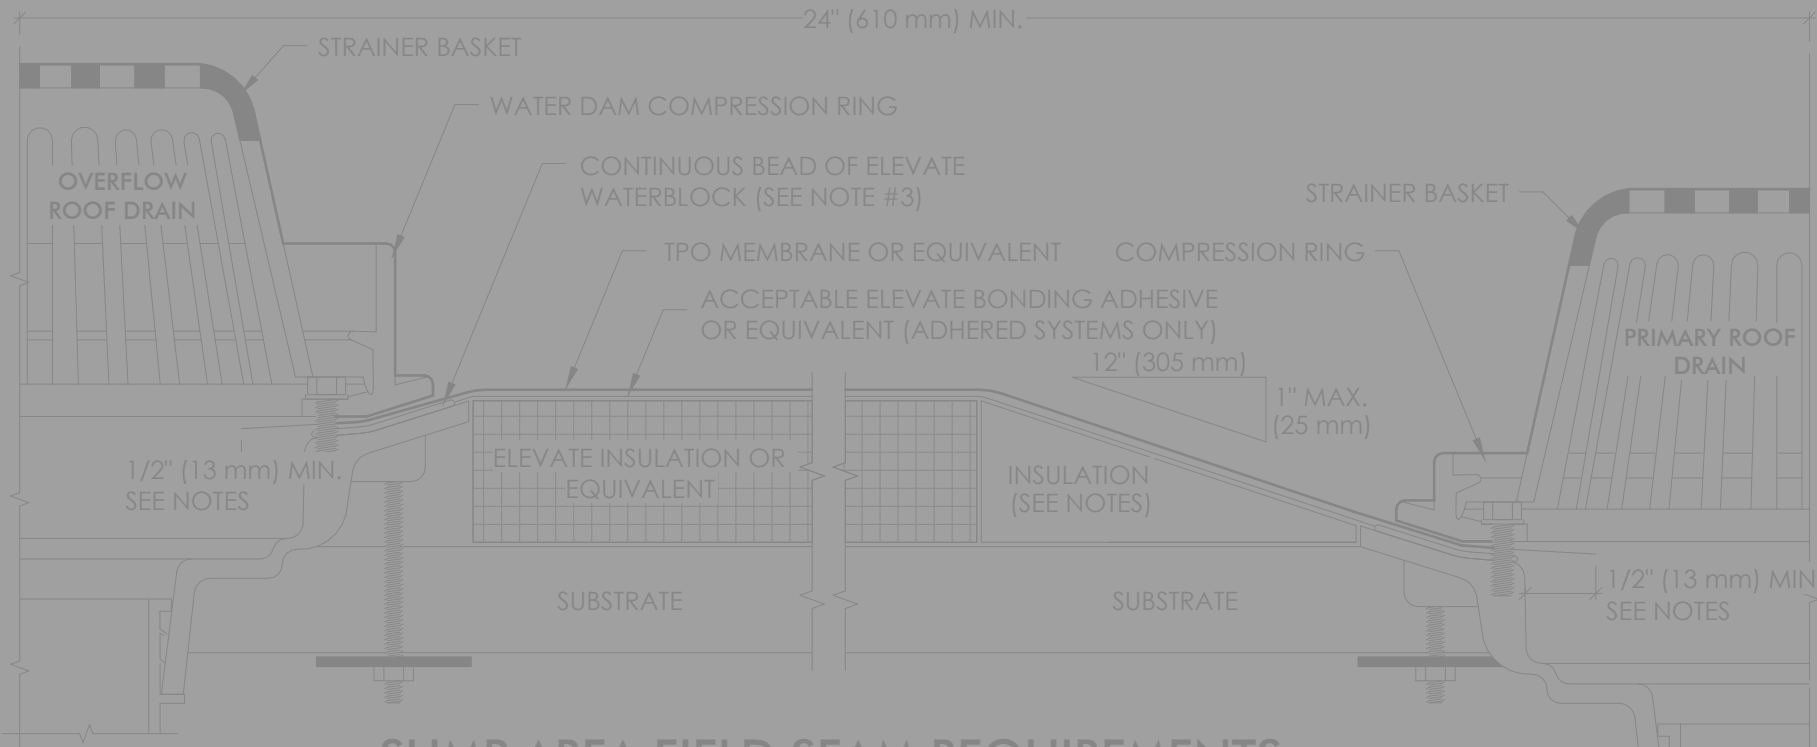


SUMP AREA FIELD SEAM REQUIREMENTS

- A. IF FIELD SEAM EDGE IS WITHIN 9" (229 mm) OF DRAIN COMPRESSION RING, TPO TARGET PATCH REQUIRED.
- B. IF FIELD SEAM EDGE IS WITHIN 9" (229 mm) TO 18" (457 mm) OF DRAIN COMPRESSION RING, HEAT WELD A LAYER OF TPO FLASHING (UNSUPPORTED) CENTERED OVER SEAM EDGE. FLASHING MUST EXTEND 3" (76 mm) MIN. BEYOND EDGE OF SUMP.

8 ROOF DRAIN WITH OVERFLOW DETAIL

A221 NTS

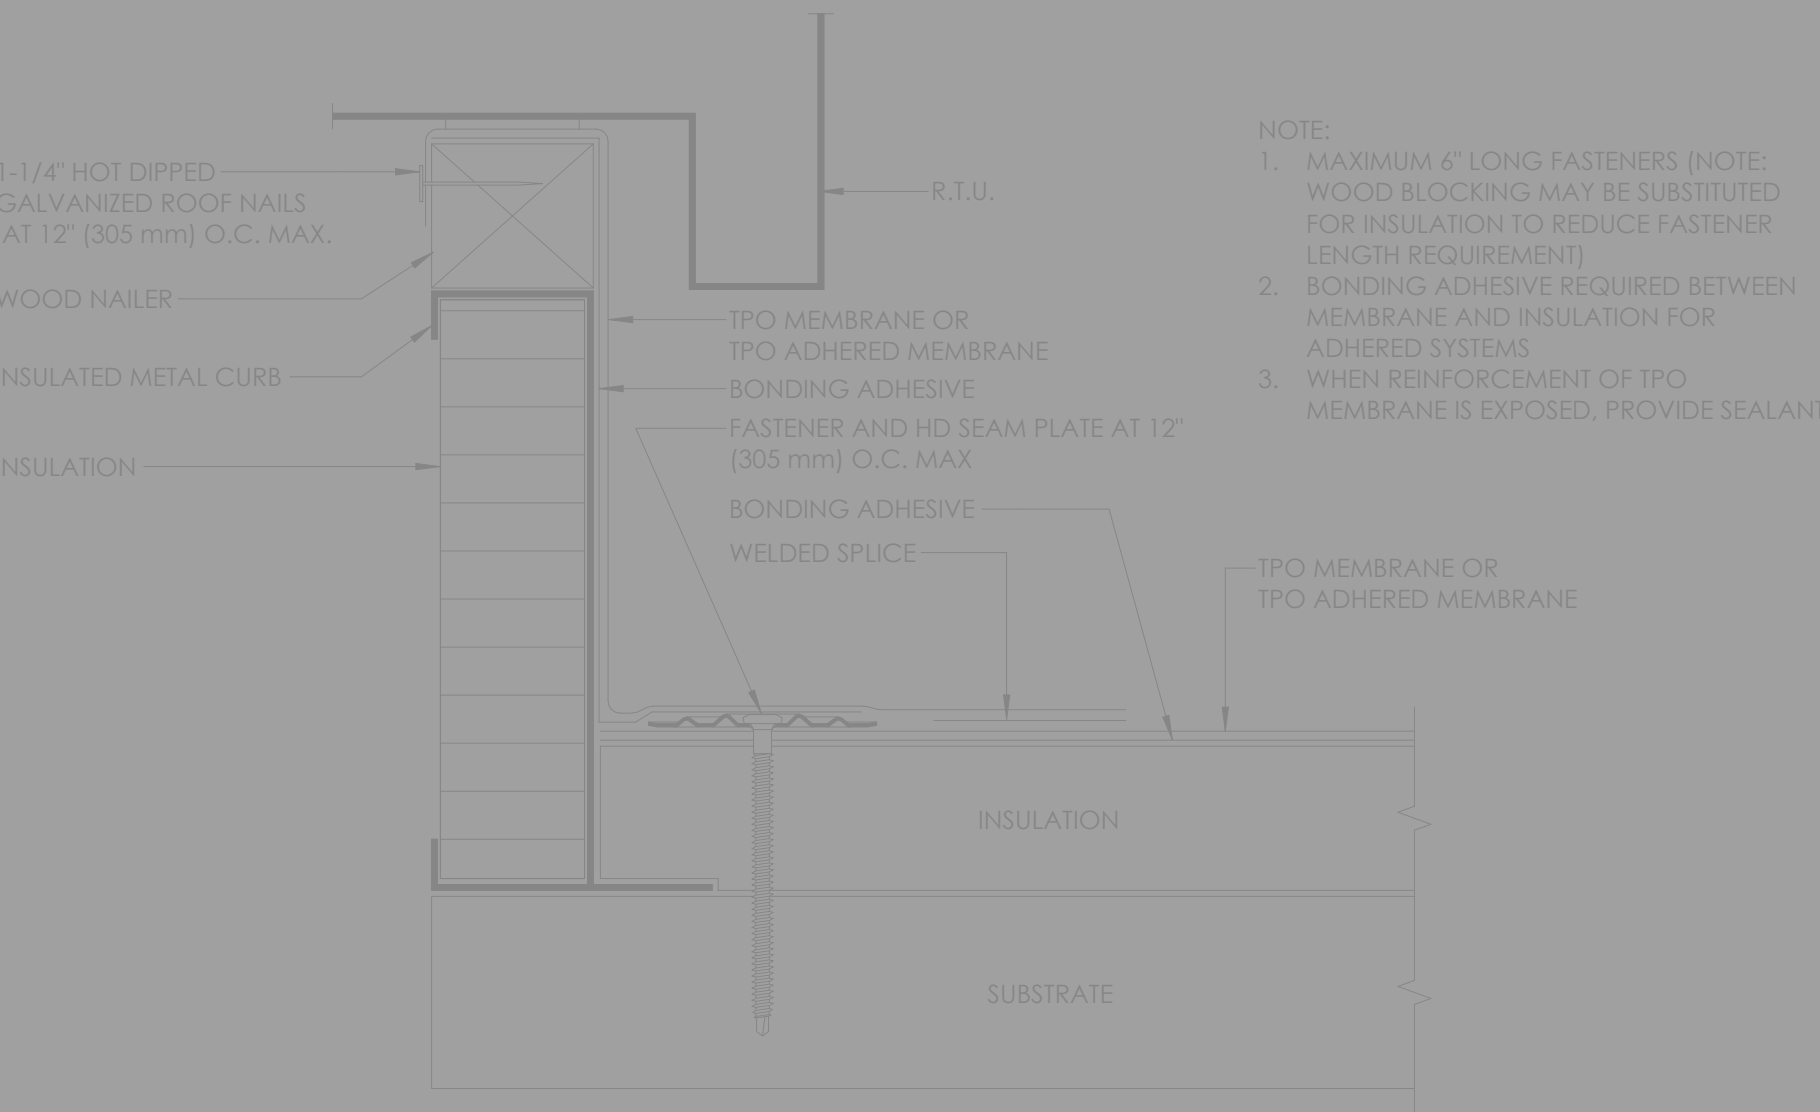


5 RUBBER ROOF CURB DETAIL

A221 NTS



1 ROOF BASE DETAIL

A221 NTS

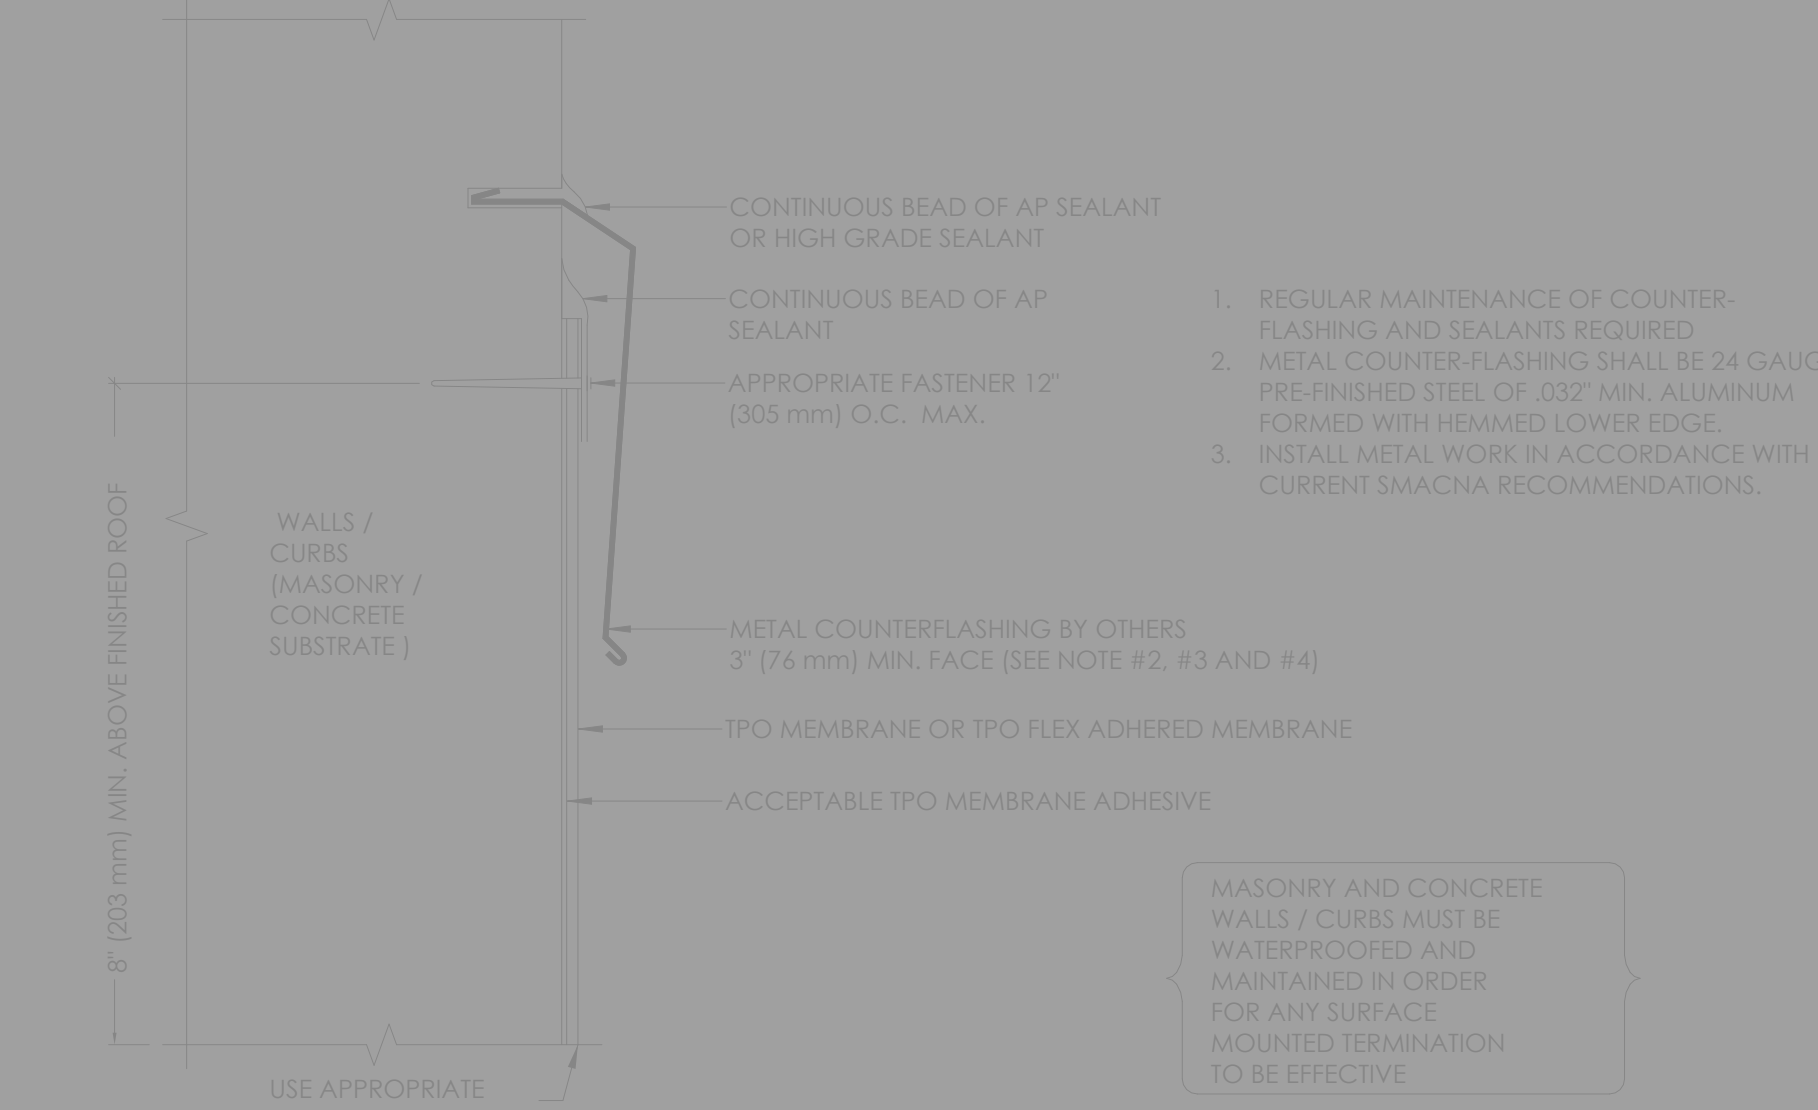


2 ROOF BASE REGLET

A221 NTS


9 WALKWAY PAD

A221 NTS

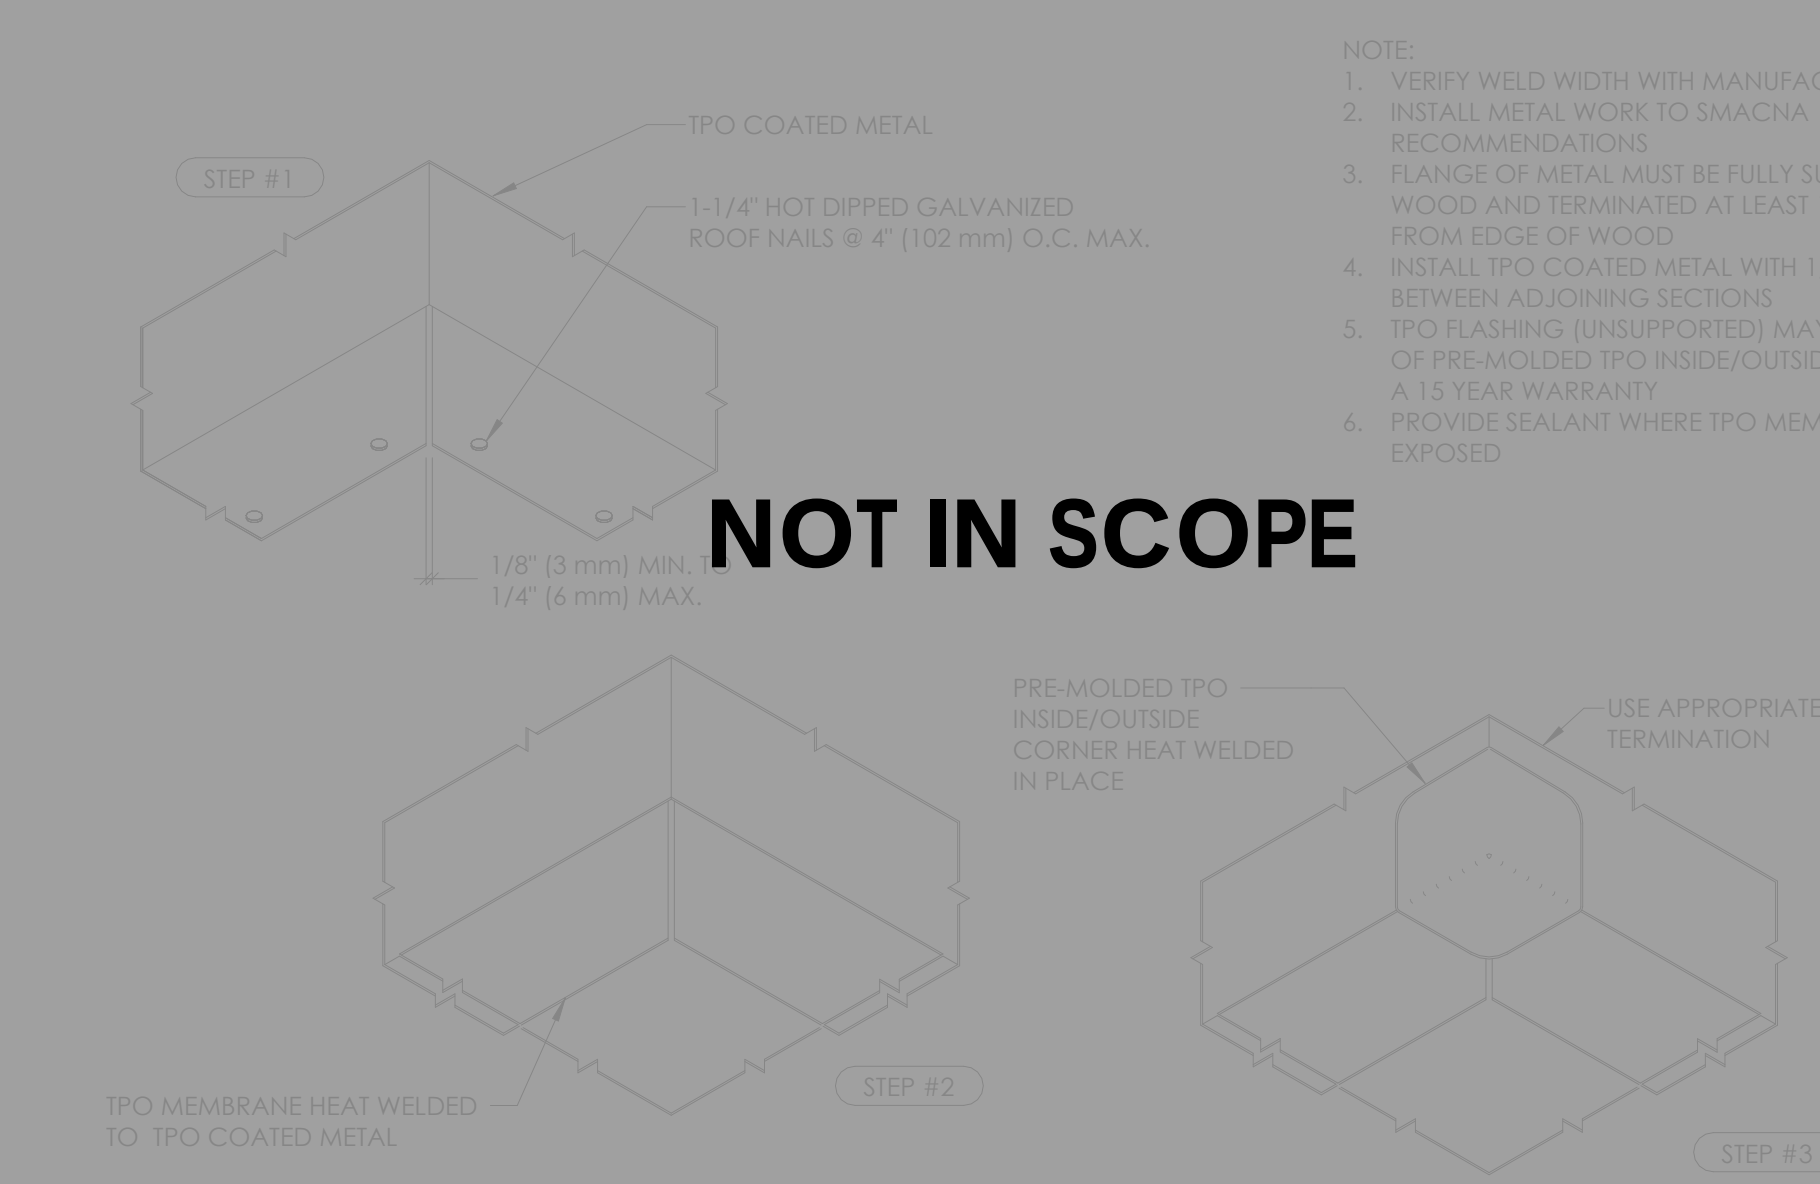

6 TPO CORNER

A221 NTS

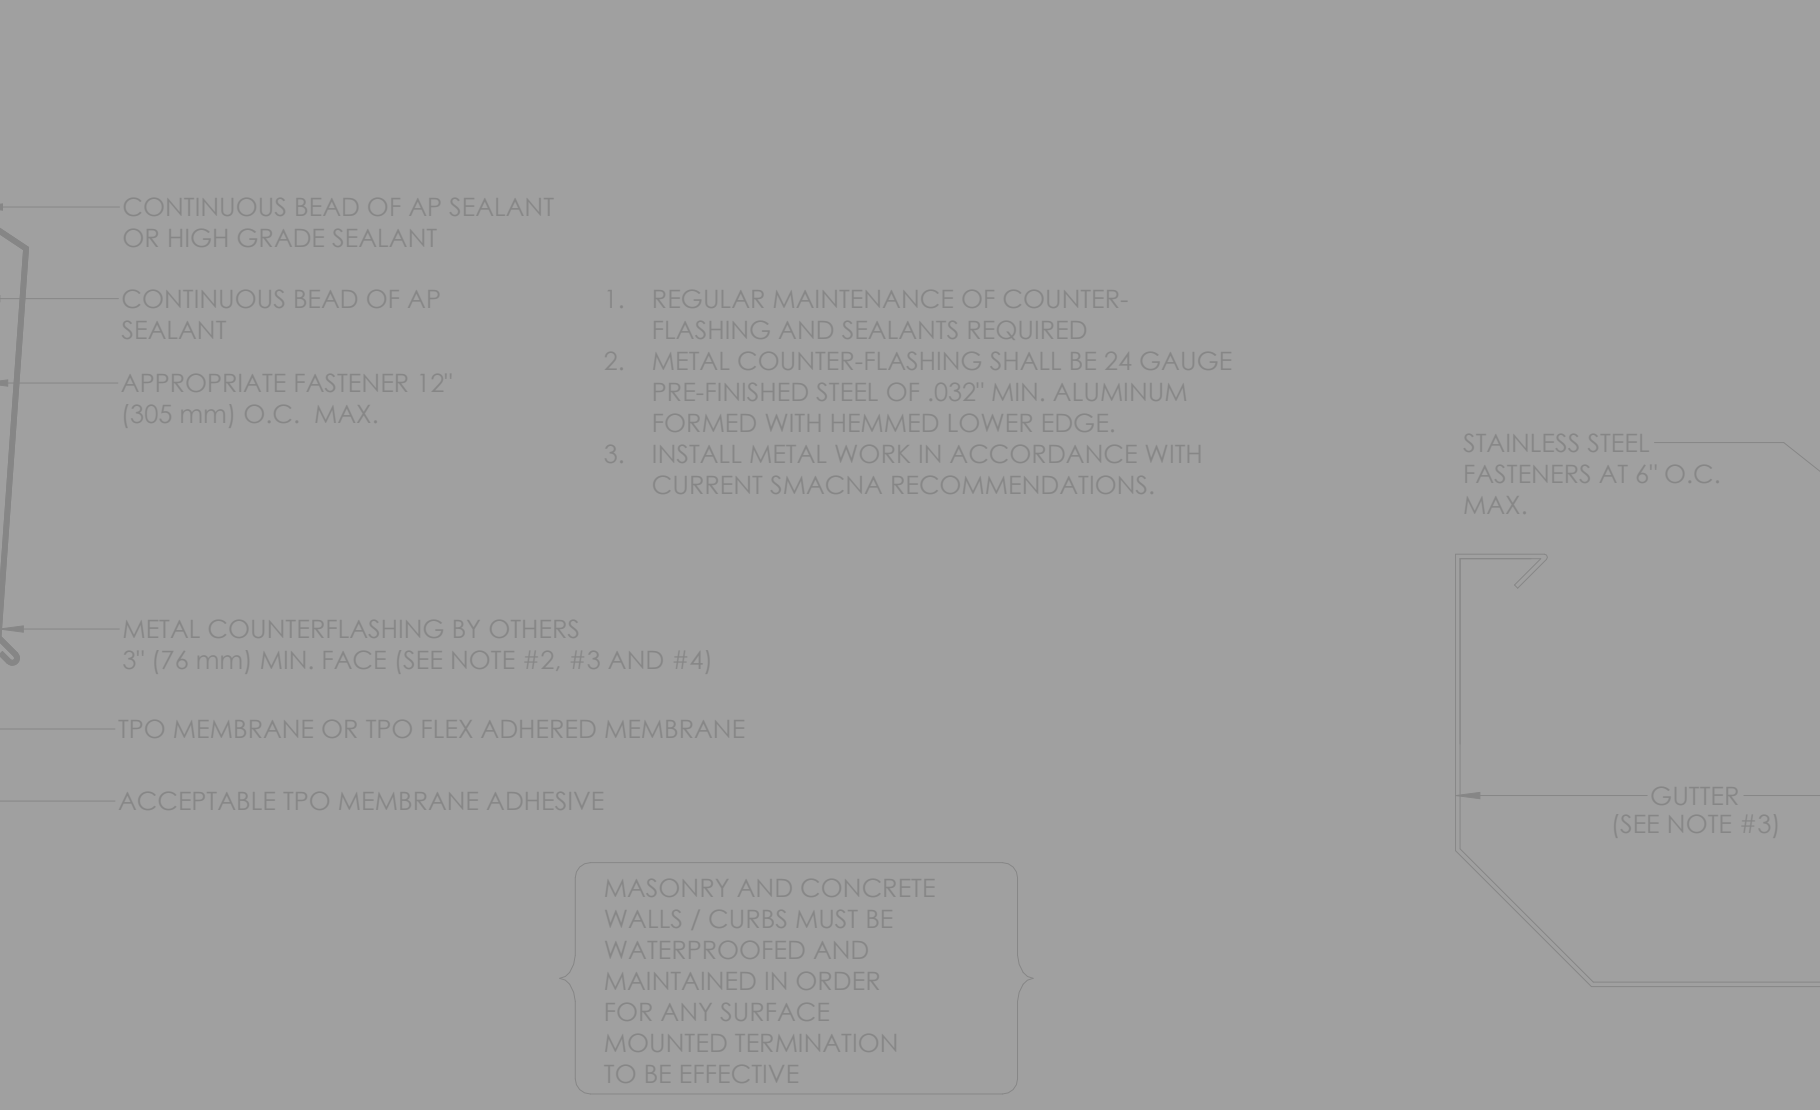


6 TPO CORNER

A221 NTS

GENERAL NOTES:

- 10' MAXIMUM LENGTH WALKWAY SECTIONS, SPACED APPROXIMATELY 1" (25 mm) MIN. TO 3" (76 mm) MAX TO ALLOW FOR DRAINAGE.
- REFER TO MANF. TECHNICAL INFORMATION FOR ADDITIONAL INFORMATION
- DO NOT INSTALL OVER MEMBRANE OR FLASHING SEAMS. ALLOW FOR A MINIMUM OF 3" GAP ON SEAM.

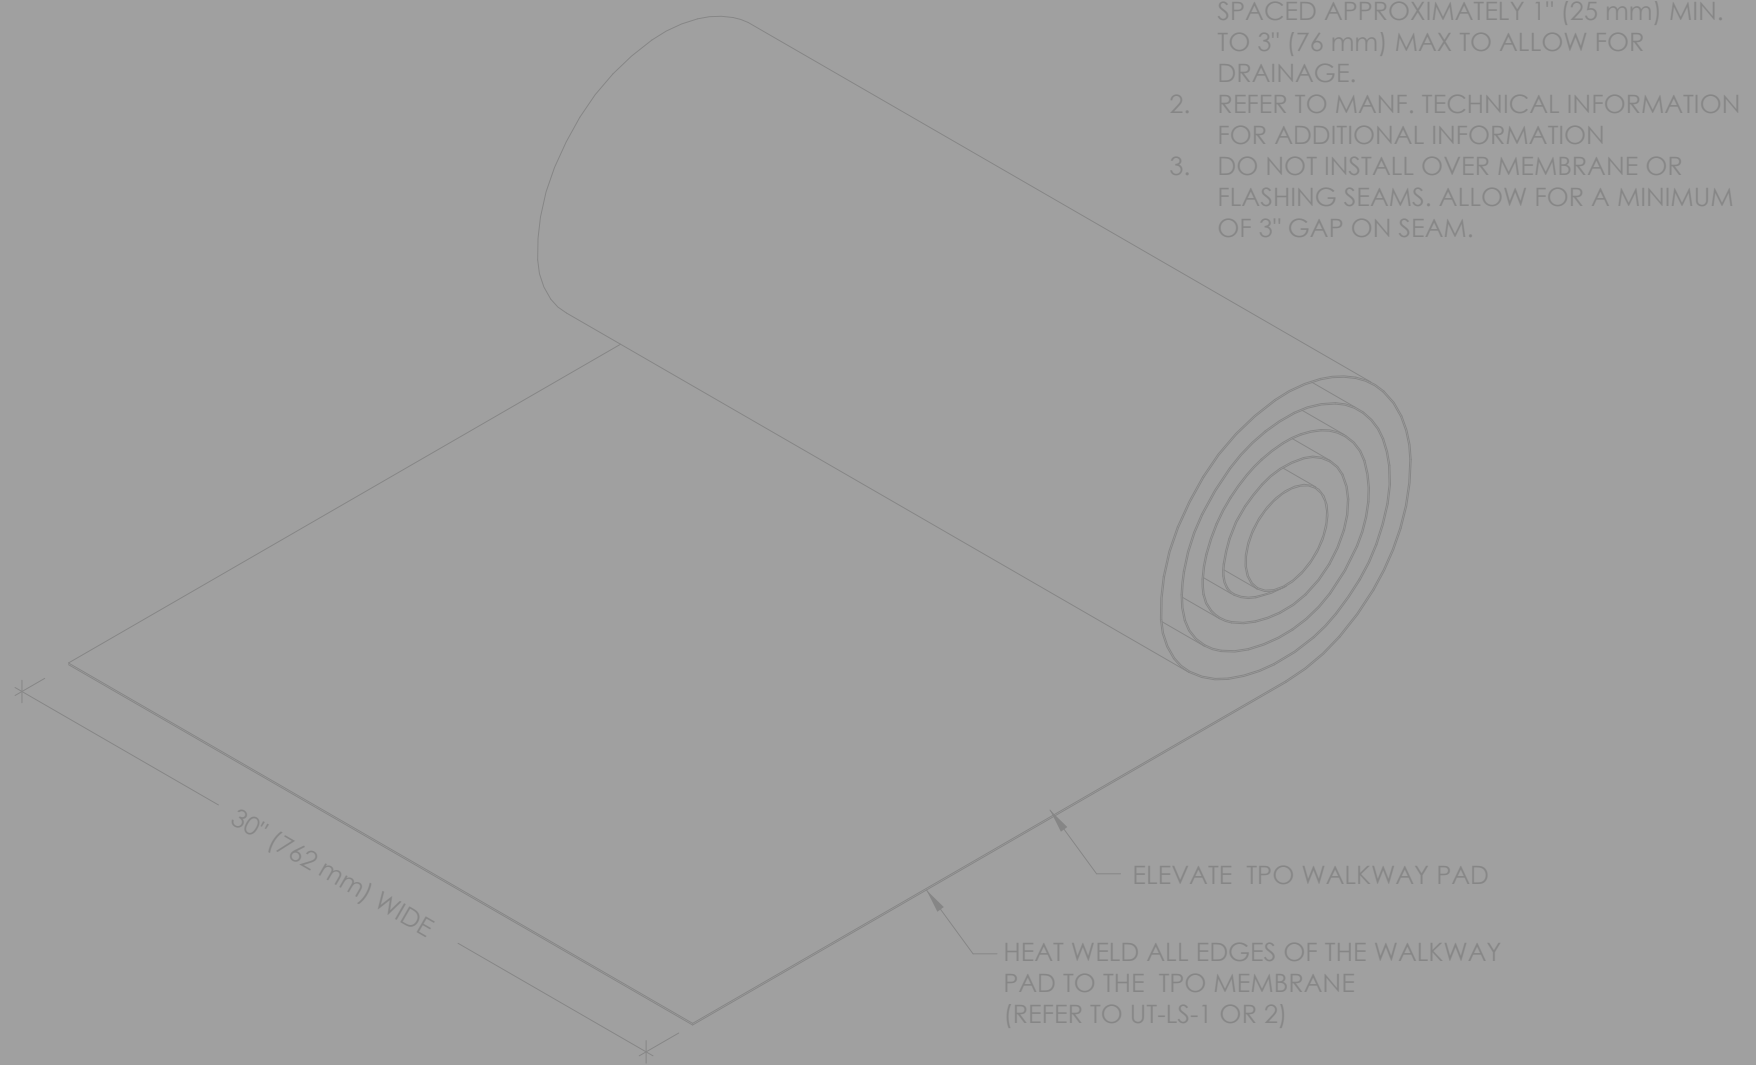


9 WALKWAY PAD

A221 NTS



9 WALKWAY PAD

A221 NTS

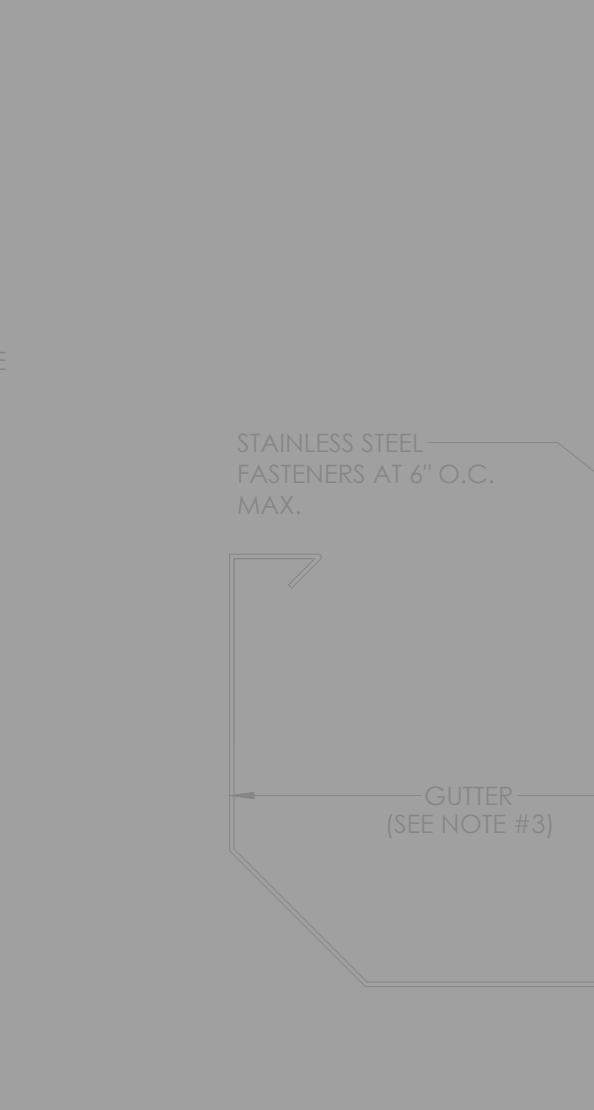


9 WALKWAY PAD

A221 NTS


GENERAL NOTES:

- 10' MAXIMUM LENGTH WALKWAY SECTIONS, SPACED APPROXIMATELY 1" (25 mm) MIN. TO 3" (76 mm) MAX TO ALLOW FOR DRAINAGE.
- REFER TO MANF. TECHNICAL INFORMATION FOR ADDITIONAL INFORMATION
- DO NOT INSTALL OVER MEMBRANE OR FLASHING SEAMS. ALLOW FOR A MINIMUM OF 3" GAP ON SEAM.

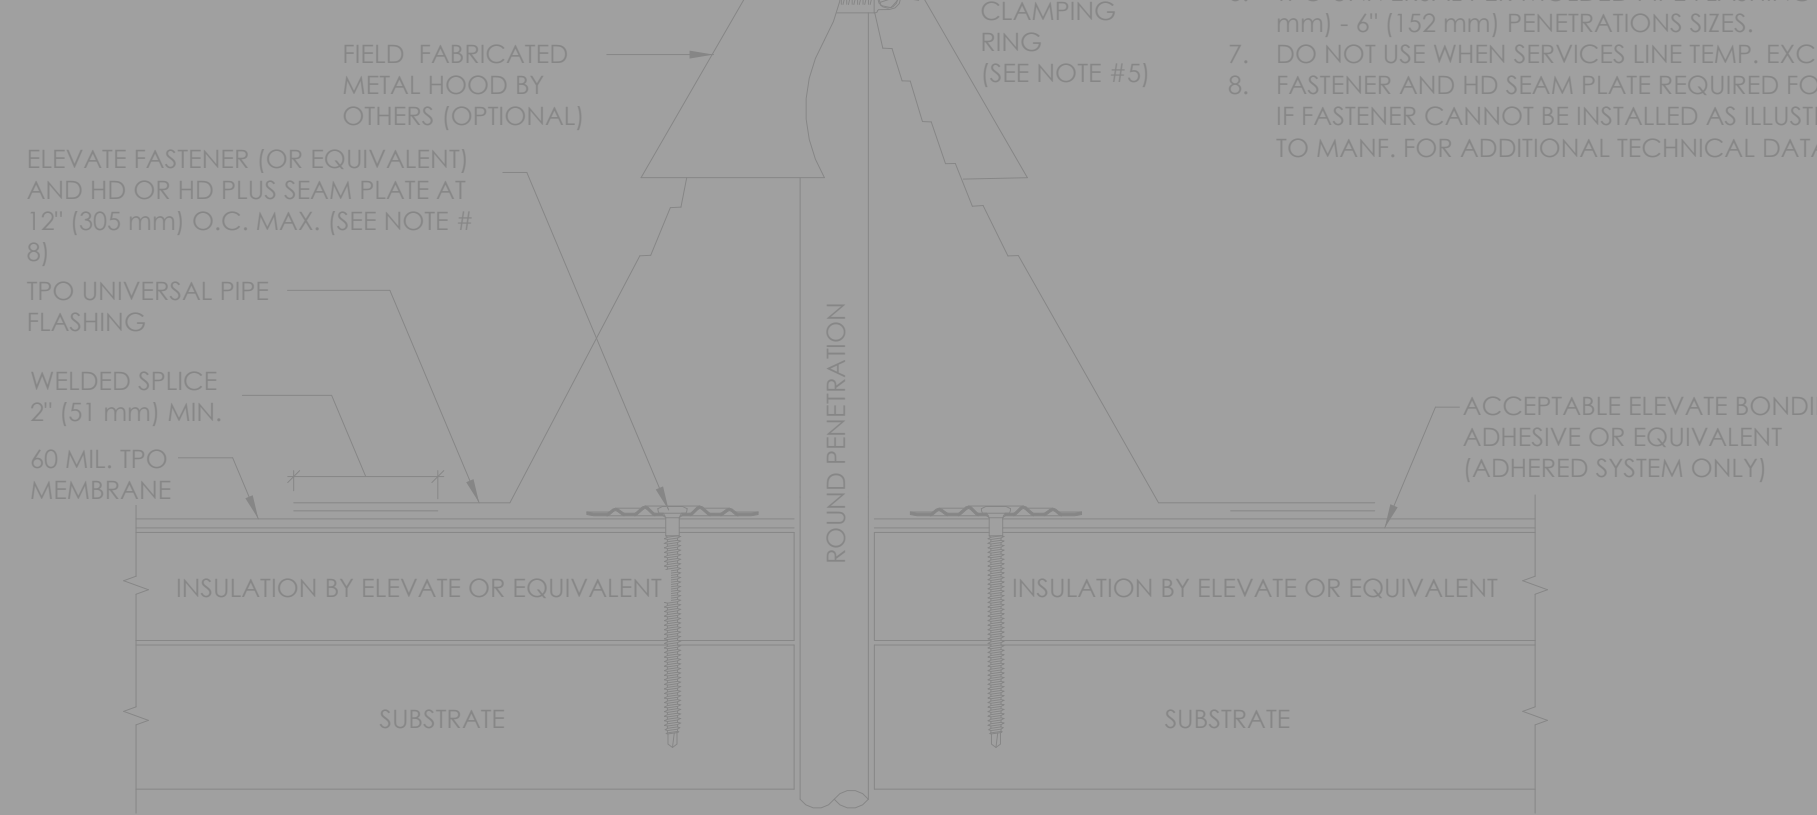


10 PIPE PENETRATION FLASHING DETAIL

A221 NTS

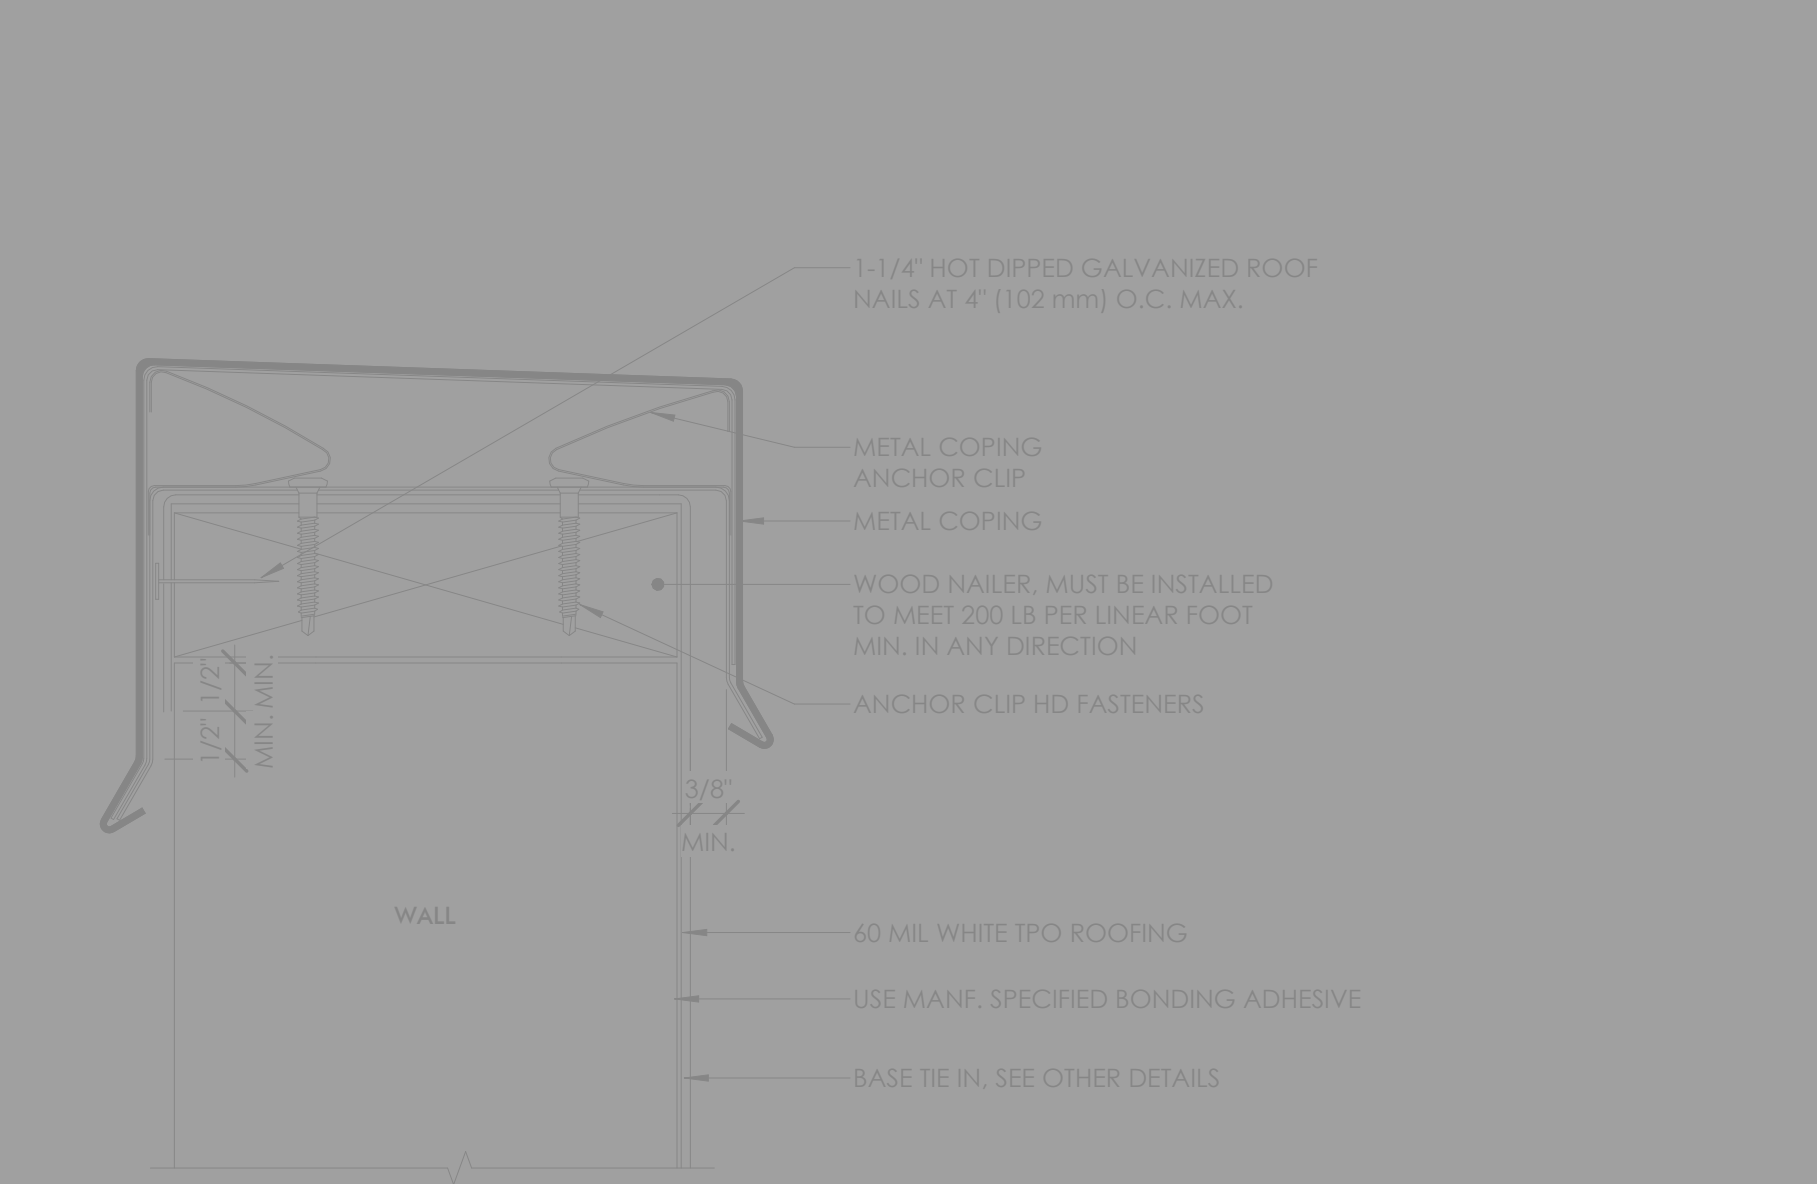

7 TERMINATION AT TOP OF WALL W/COPING

A221 NTS

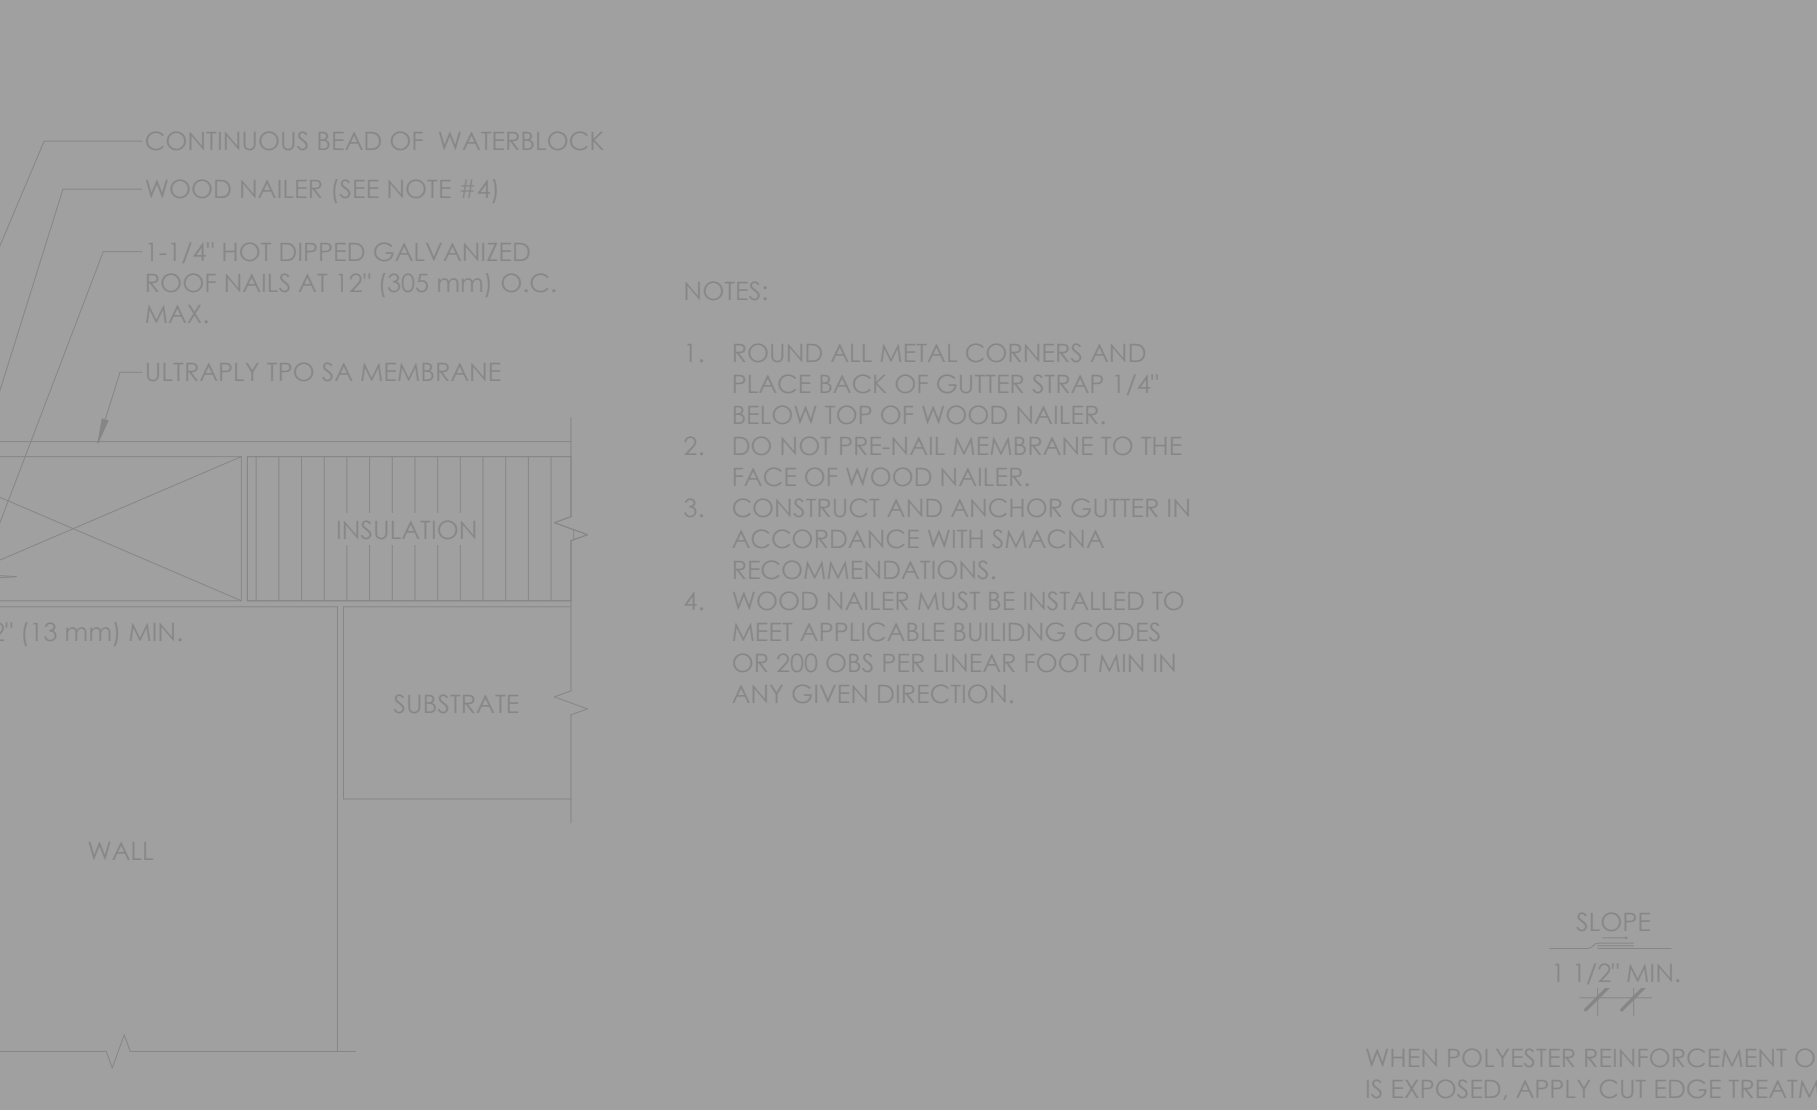


7 TERMINATION AT TOP OF WALL W/COPING

A221 NTS

GENERAL NOTES:

- ELEVATE TPO IS USED AS THE BASIS OF DESIGN
- NOT USED
- PIPE MUST BE ANCHORED TO ENSURE STABILITY.
- PRE-MOLDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING)
- APPLY AP SEALANT BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING.
- TPO UNIVERSAL PER-MOLDED PIPE FLASHING FITS 1" (25 mm) - 6" (152 mm) PENETRATIONS SIZES.
- DO NOT USE WHEN SERVICES LINE TEMP. EXCEEDS 140 °F. FASTENER AND HD SEAM PLATE REQUIRED FOR MAS ONLY.
- IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO MANF. FOR ADDITIONAL TECHNICAL DATA.

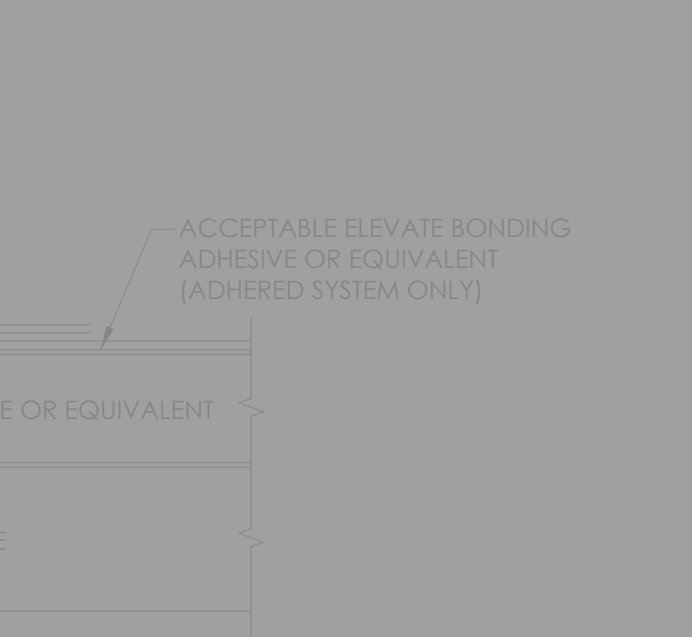

7 TERMINATION AT TOP OF WALL W/COPING

A221 NTS



7 TERMINATION AT TOP OF WALL W/COPING

A221 NTS



7 TERMINATION AT TOP OF WALL W/COPING

A221 NTS