


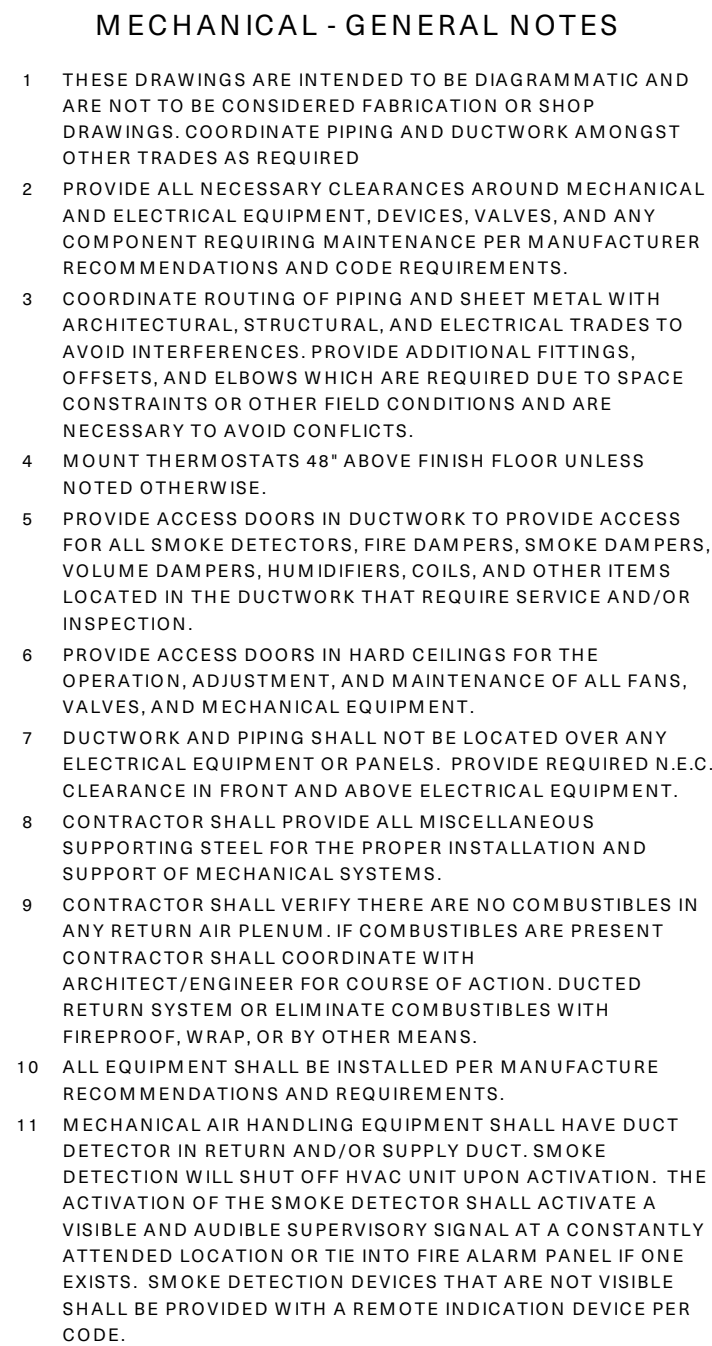

- A PROVIDE A CEILING RADIATION DAMPER COMPLYING WITH UL 555C. 212 DEG SETTING FUSIBLE LINK.
- B TERMINATE 3" FURNACE INTAKE AND FLUE UP THROUGH ROOF PER MANUFACTURE REQUIREMENTS. REFER TO ARCHITECTURAL FOR ROOF FLASHING.
- C TERMINATE 4" DRYER EXHAUST UP THROUGH ROOF AND TERMINATE WITH GOOSENECK LESS BIRDSCREEN.