



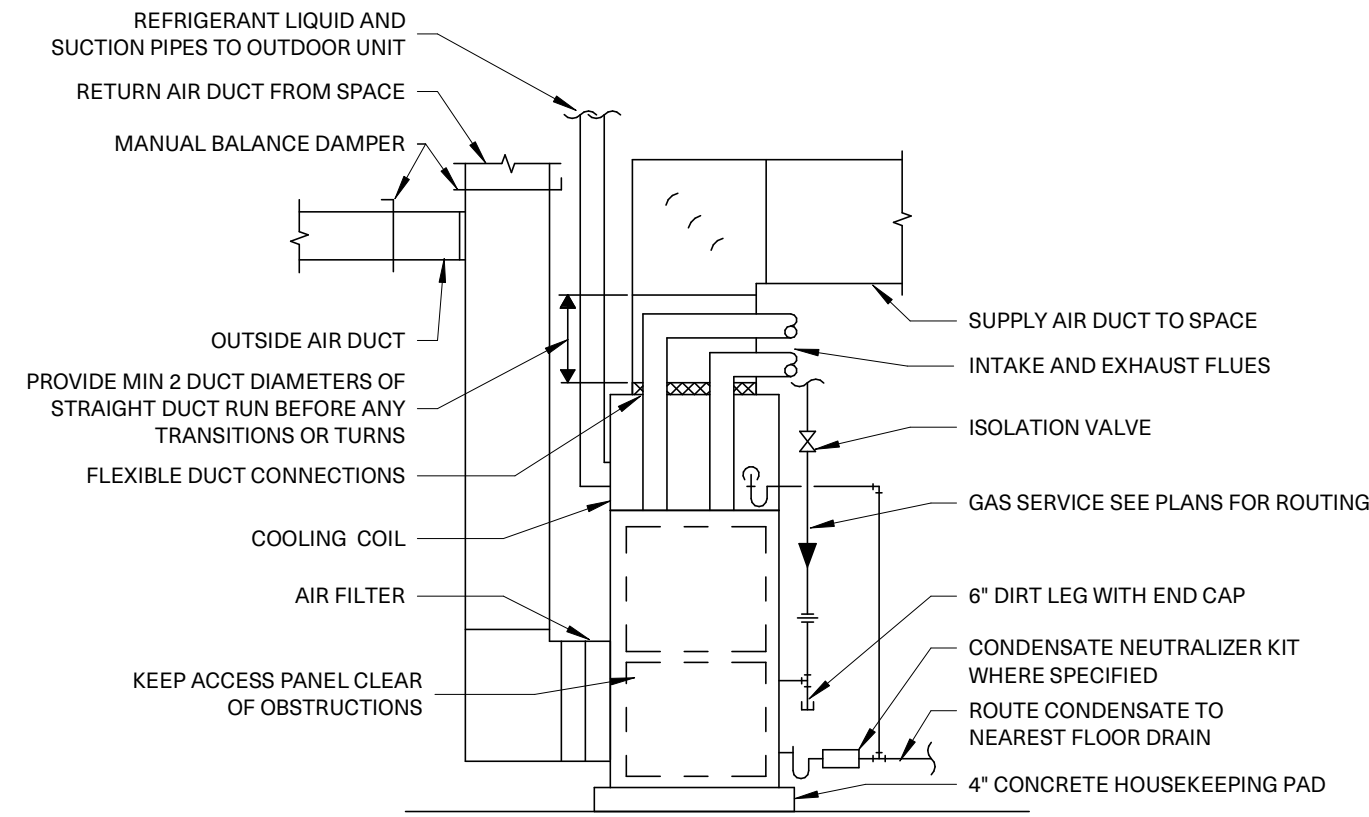


HIGH EFFICIENCY GAS FURNACE AND COOLING COIL DIAGRAM AND INSTALLATION DETAIL

NO SCALE

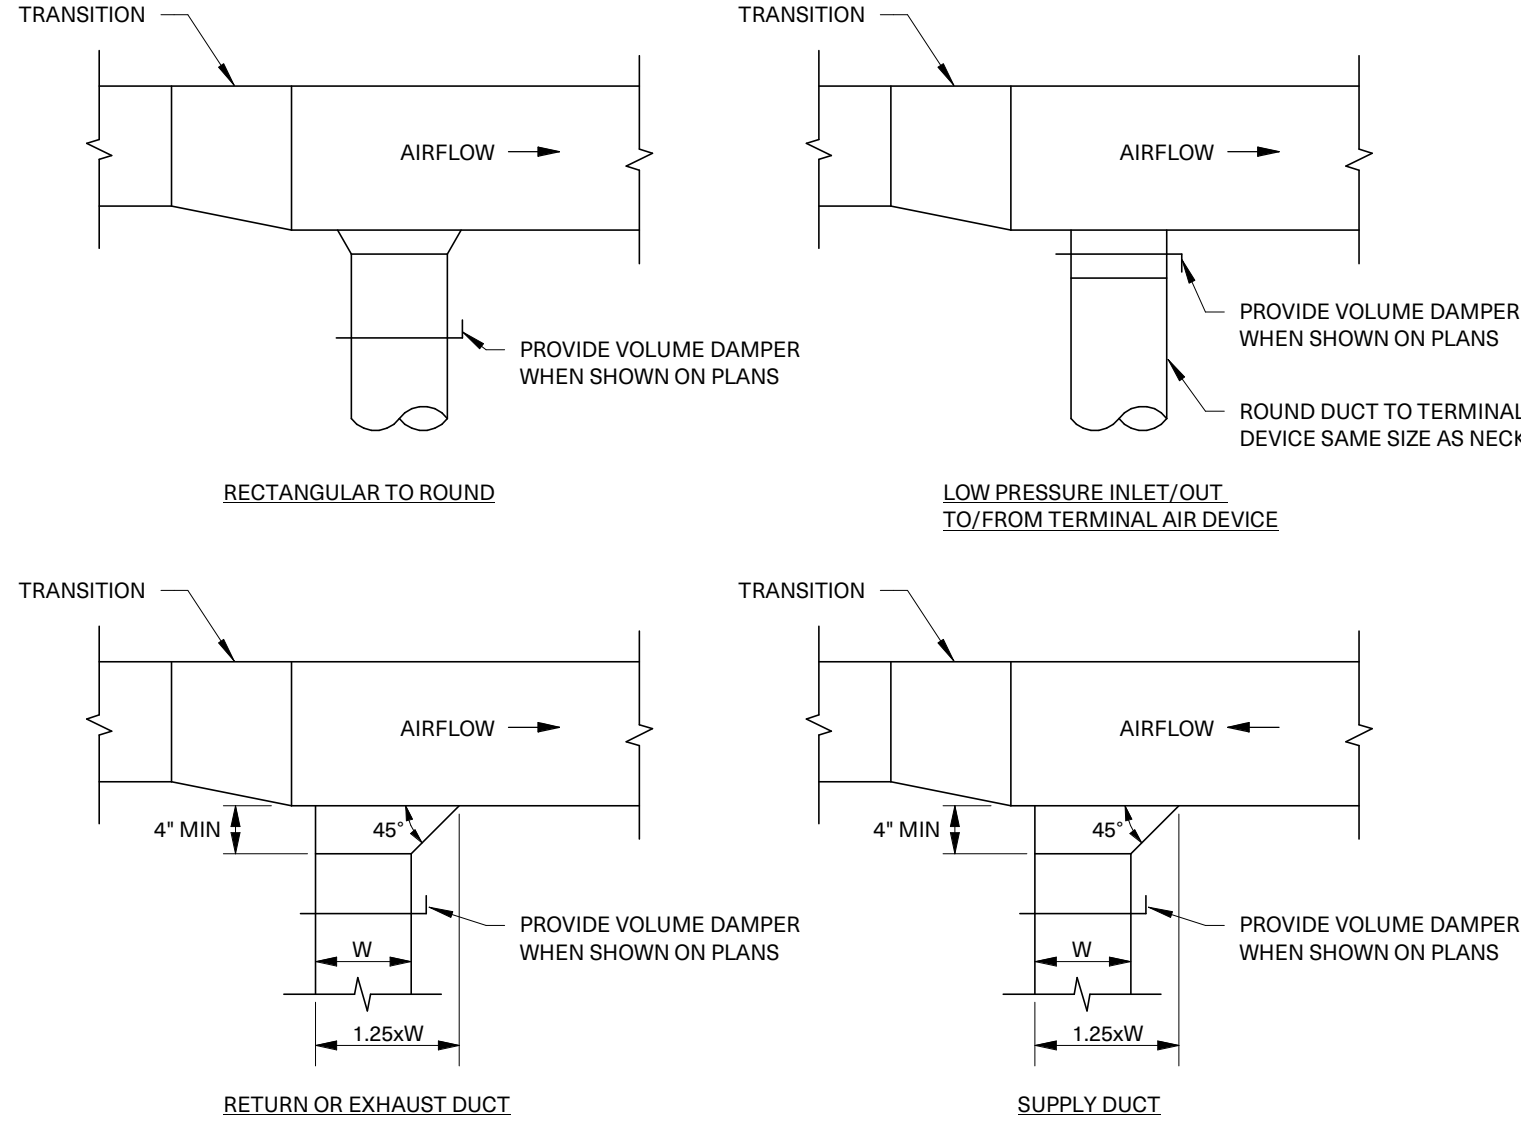


RECTANGULAR BRANCH DUCT DETAILS

NO SCALE

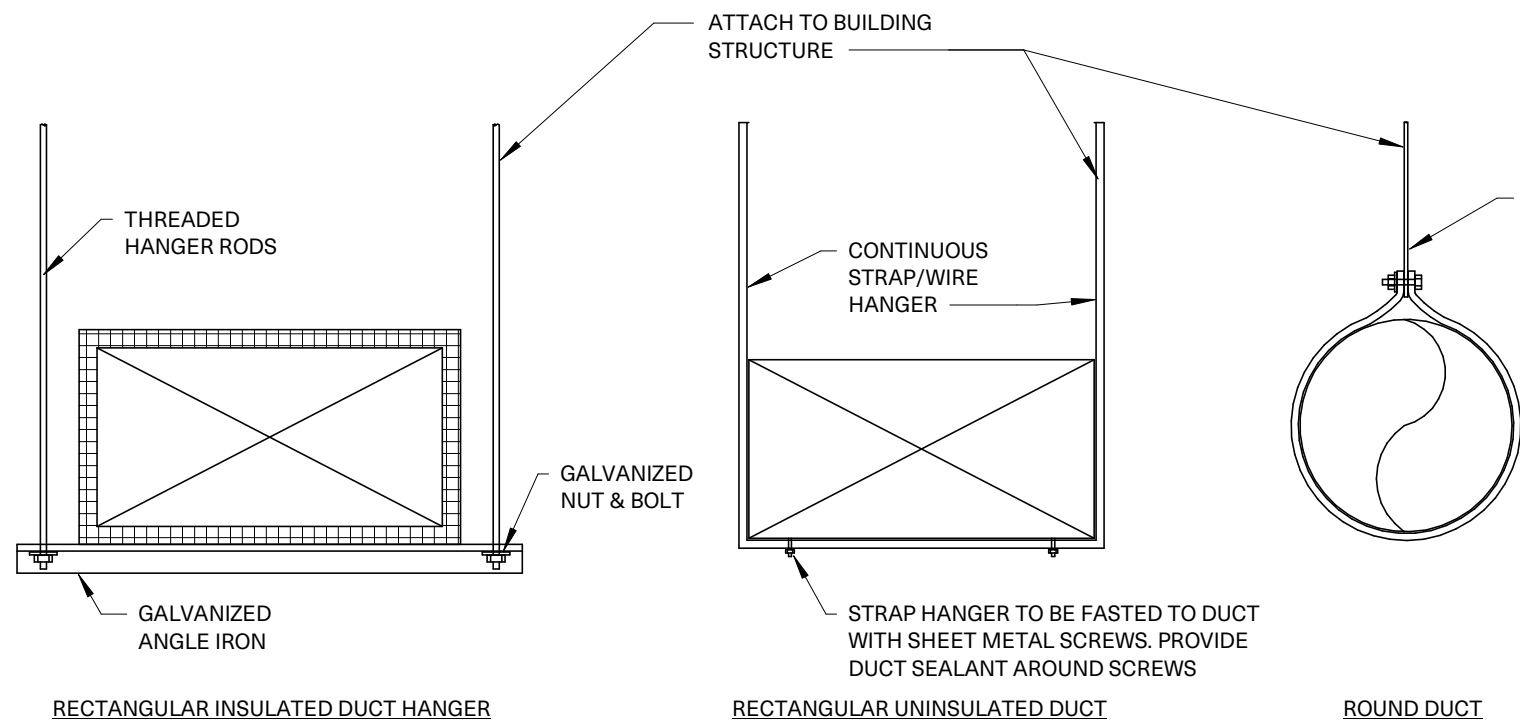


DUCT SUPPORT DETAIL

NO SCALE

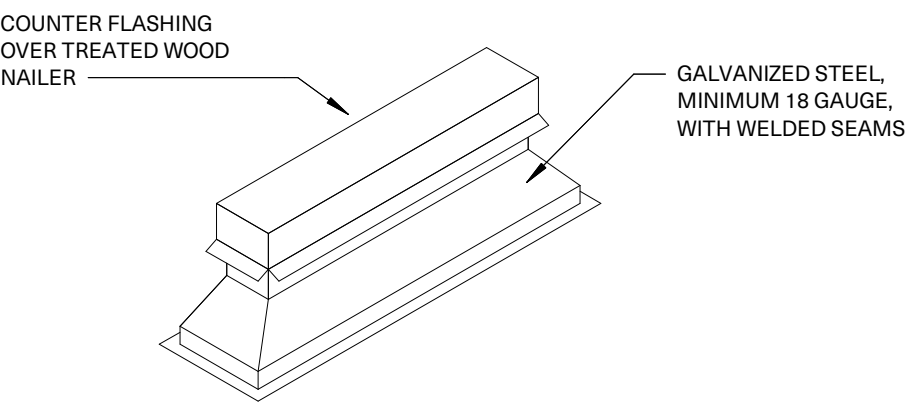


EQUIPMENT RAIL FOR ROOF MOUNTING

NO SCALE

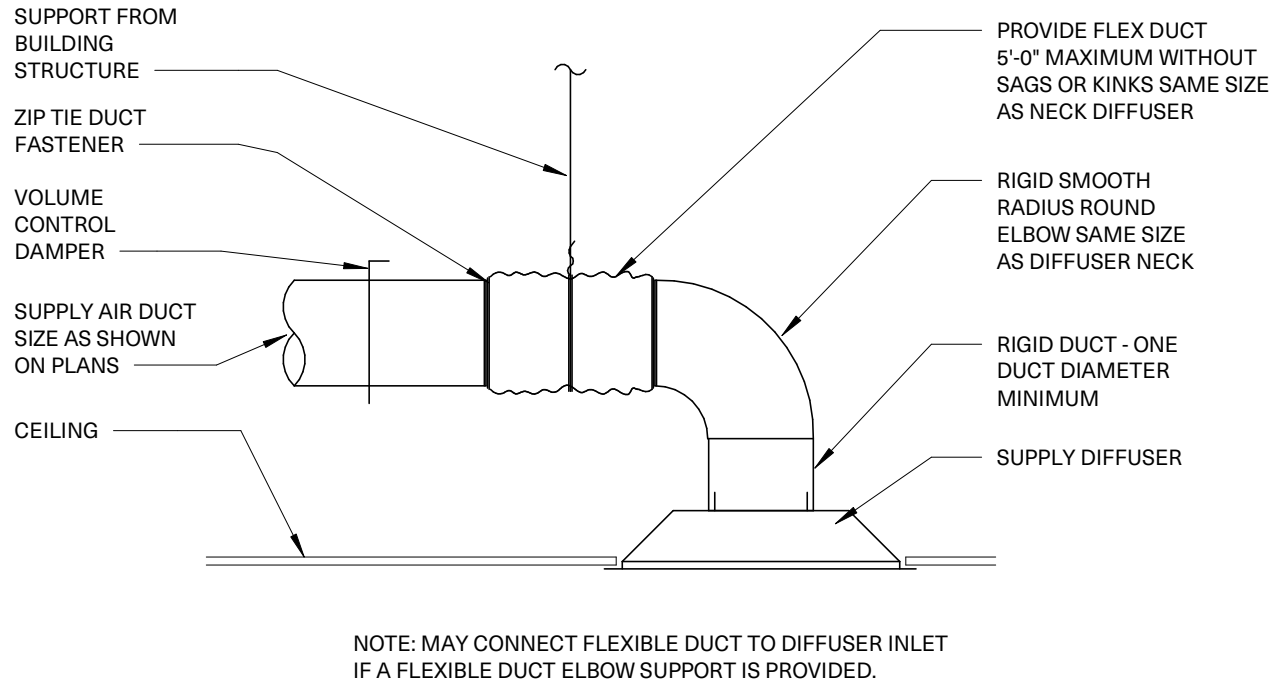


ROUND NECK SUPPLY AIR DIFFUSER DETAIL

NO SCALE

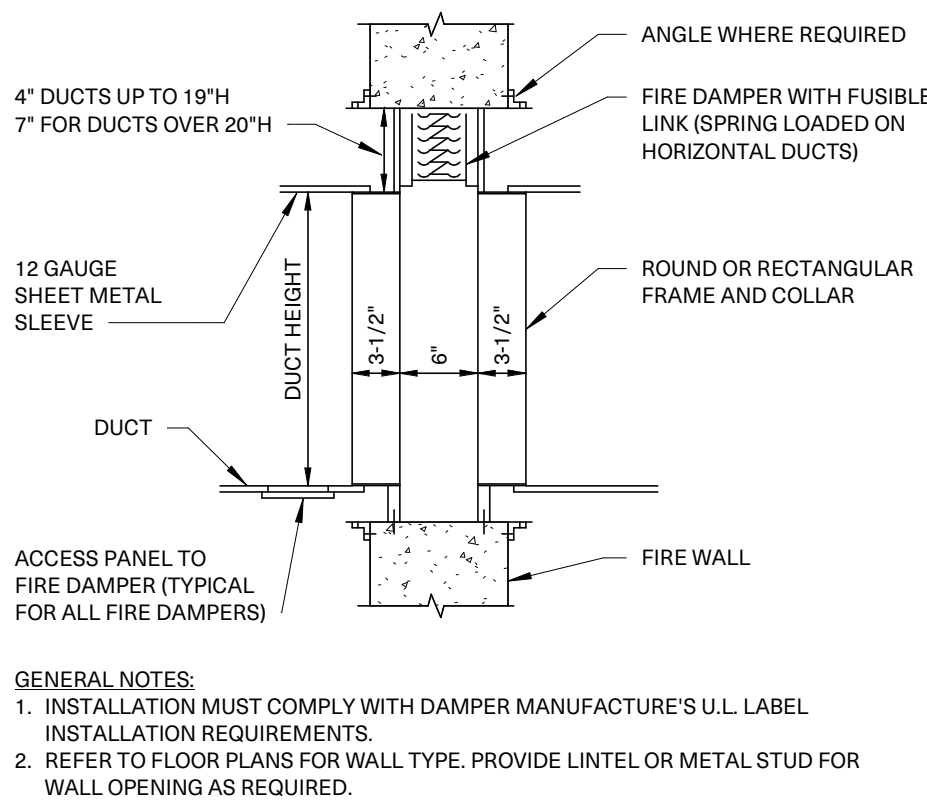

VERTICAL FIRE DAMPER DETAIL


NO SCALE

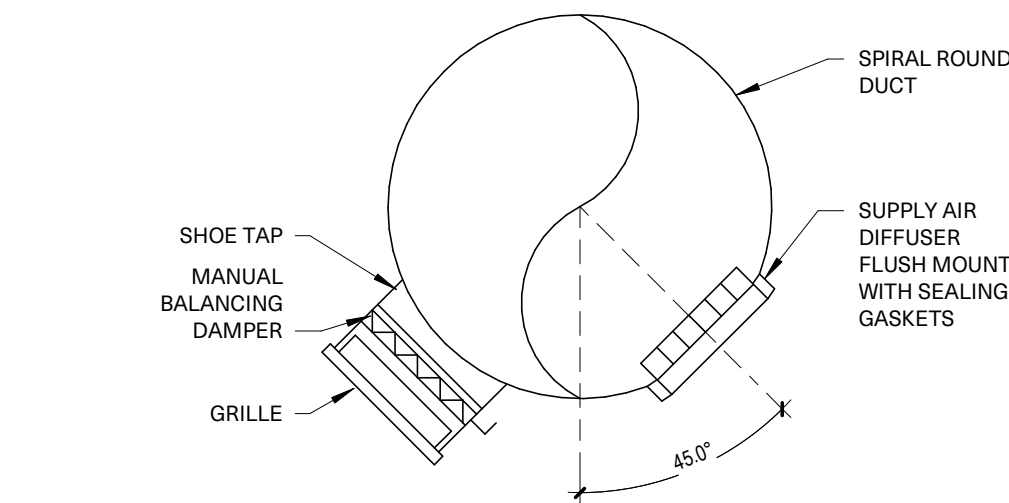

EXPOSED ROUND DUCT DIFFUSER DETAIL

NO SCALE


- NOTES:
1. REFER TO FLOOR PLAN FOR LOCATION AND QUANTITY.
2. REFER TO SCHEDULES FOR MOUNTING/GRILLE TYPE

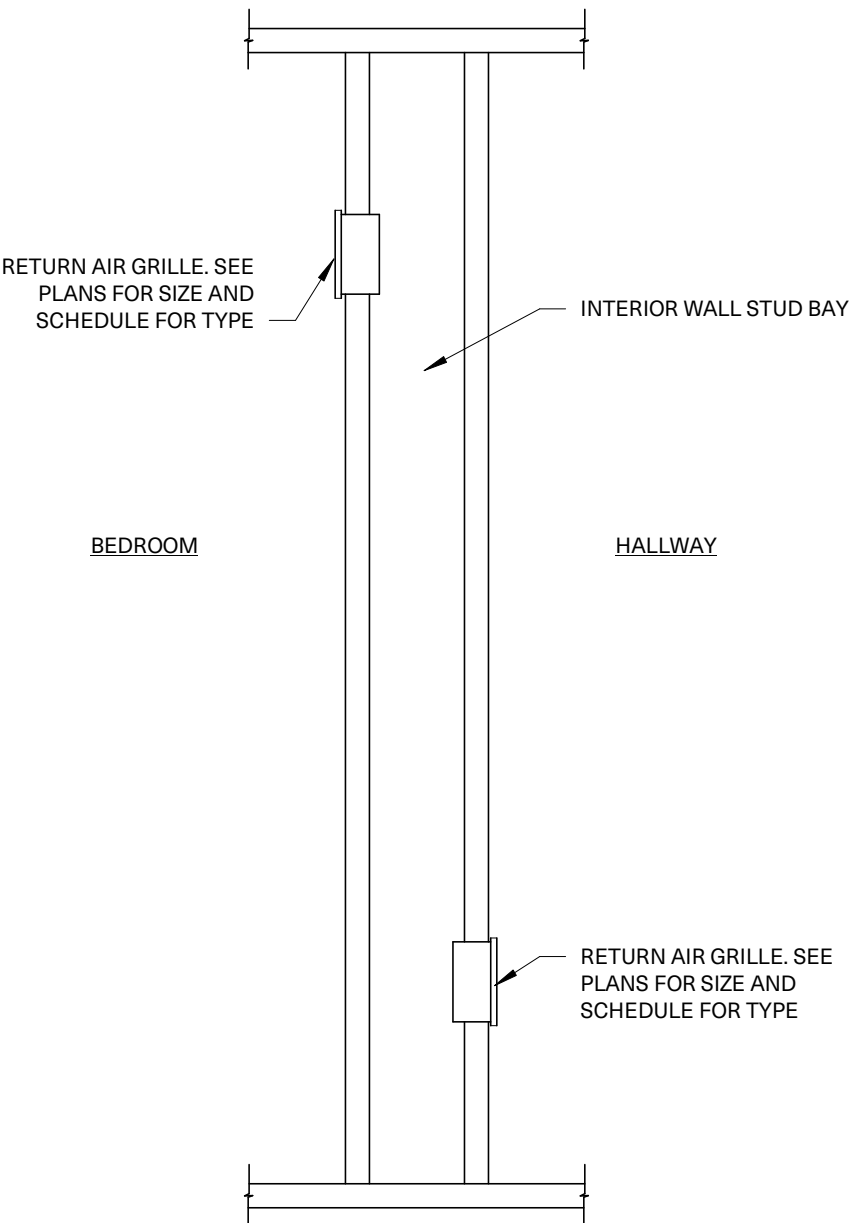

- NOTES:
1. INSTALL RETURN GRILLES BETWEEN WALL STUDS.
2. INSTALL RETURN GRILLE IN BEDROOM HIGH ON WALL.
3. INSTALL RETURN GRILLE 1'-6\"/>







HIGH/LOW RETURN GRILLE DETAIL

NO SCALE

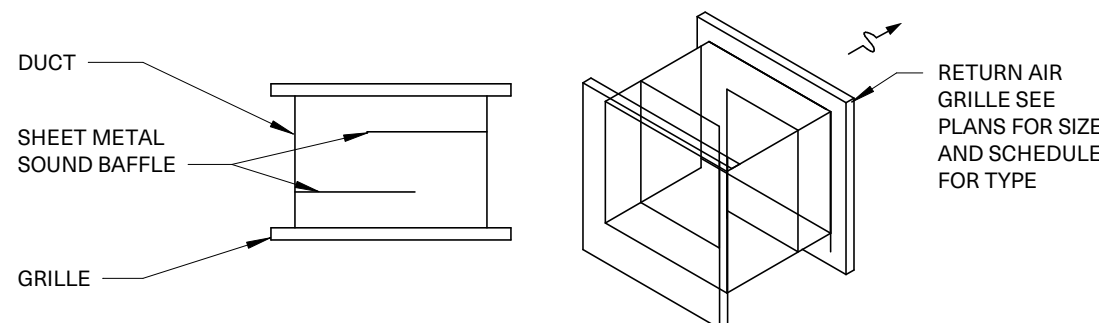

BEDROOM RETURN AIR TRANSFER GRILLE DETAIL

NO SCALE

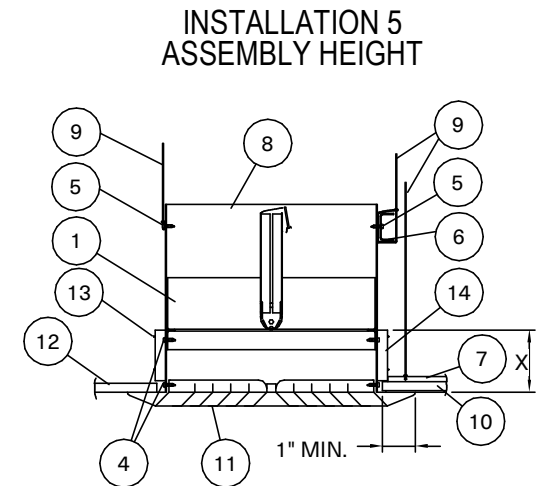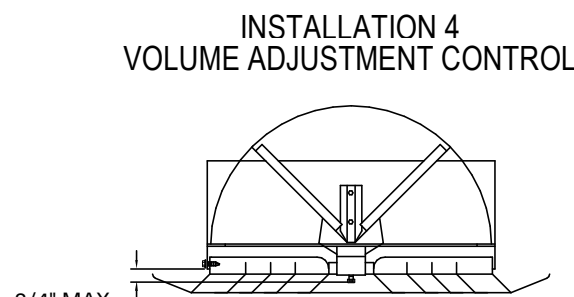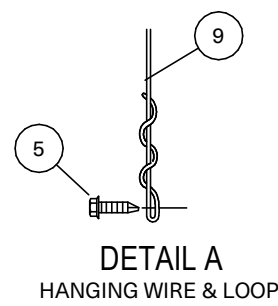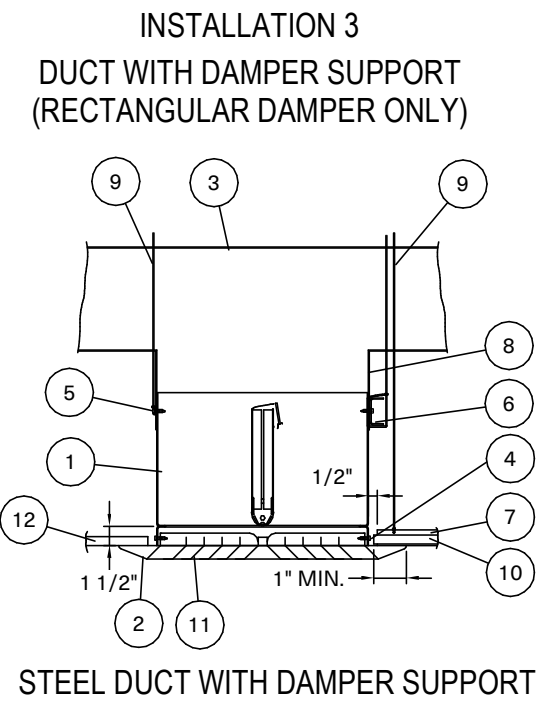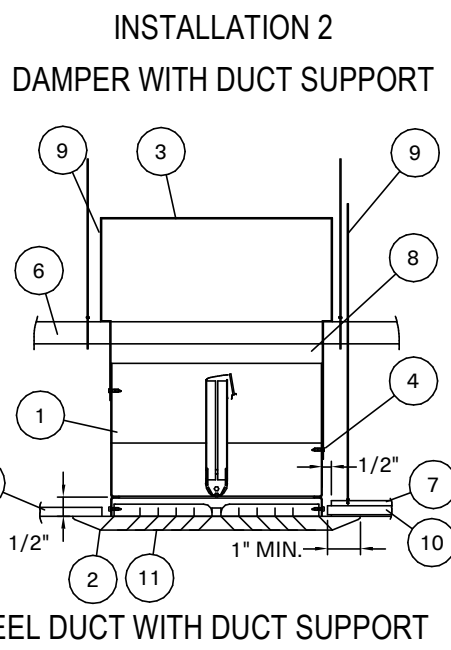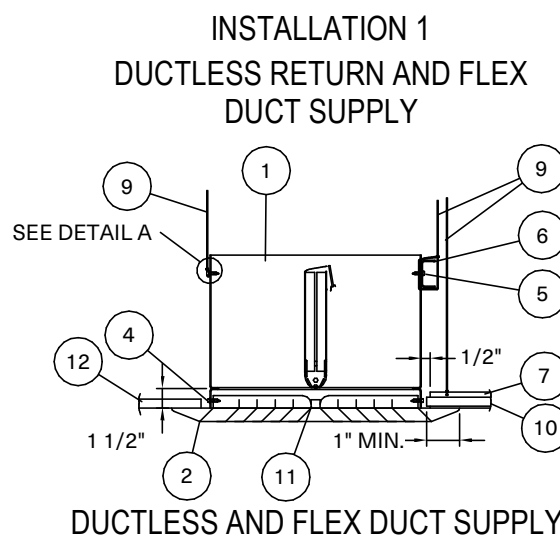


- ITEM DESCRIPTION
1. DAMPER
2. GRILLE FRAME (20 GA. MIN)
3. DUCT
4. #8 SHEET METAL SCREW
5. #10 SHEET METAL SCREW
6. 16 MSG X 1-1/2\"/>

- GENERAL NOTES:
1. INSTALLATION MUST COMPLY WITH DAMPER MANUFACTURE'S U.L. LABEL INSTALLATION REQUIREMENTS.
2. REFER TO FLOOR PLANS FOR LOCATIONS


CEILING RADIATION DAMPER INSTALLATION DETAIL

NO SCALE

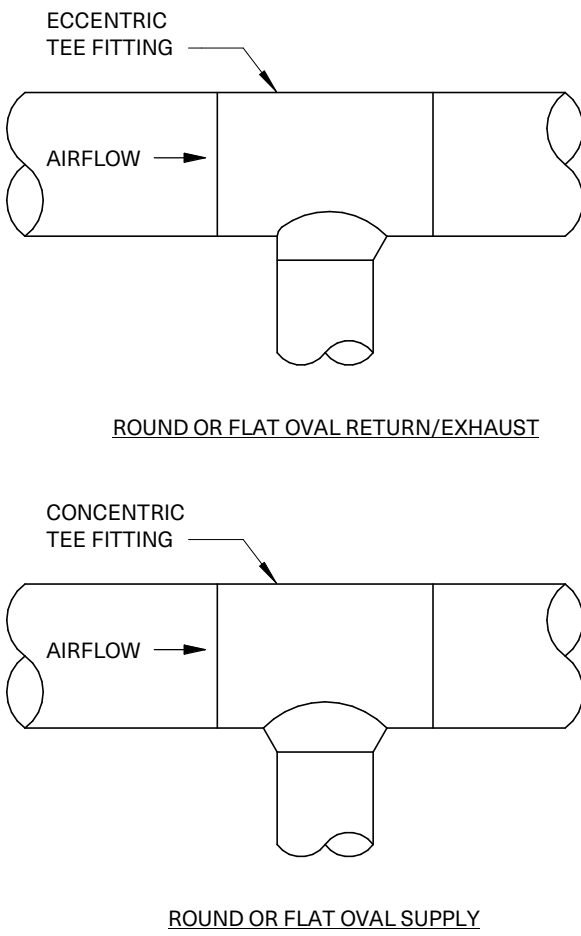

ROUND BRANCH DUCT DETAILS

NO SCALE

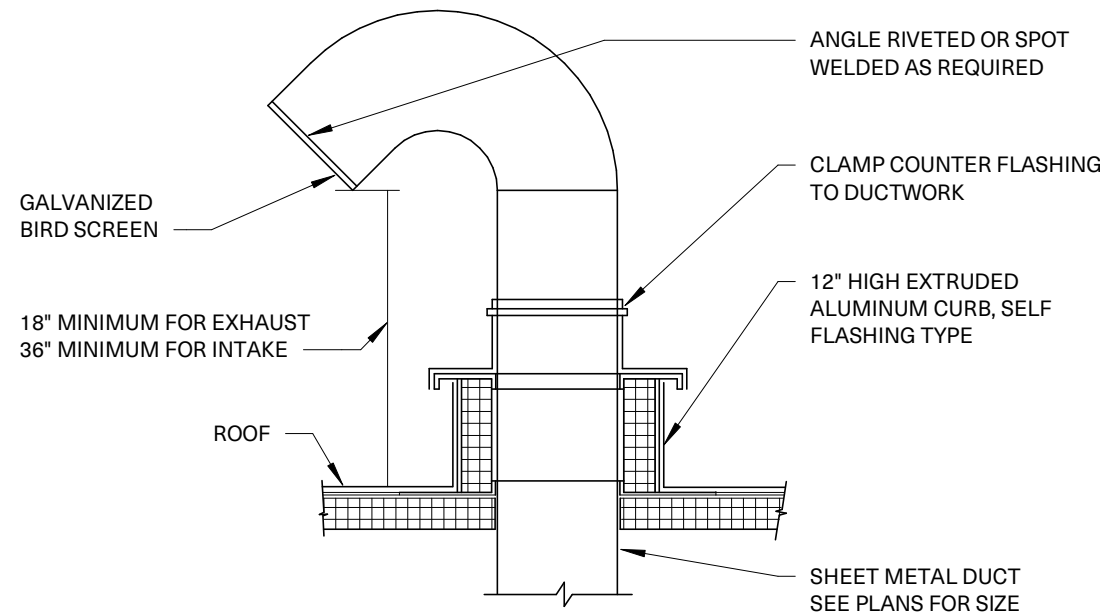

GOOSENECK DETAIL

NO SCALE